

CHAMUNDESHWARI ELECTRICITY SUPPLY CORPORATION LTD.,




mate No: SOK-397

Date: 29/08/2022.

Sketch Shows for APS to 1No's of Power installation's (LT-5) of 20HP load infavour of Sri.Prasanthkumar K.M S/o Mahadevappa K.S (anana Floor Mill) Site No-29 @ Gejjagalli Village Limits pertains to O&M-Kadakola Section of Chamundipuram Sub-Division.

INDEX	
—	Existing 115V 4 wire HT line
—	Existing 115V 3 wire HT line
△	Existing 63KVA DTC
—	Existing 4 wire 40V LT
X	Existing 8mH 4w/3w poles
—	Existing 3 wire HT line
- - -	Proposed single wire HT line
⊗	Proposed 8mH 3w pole.

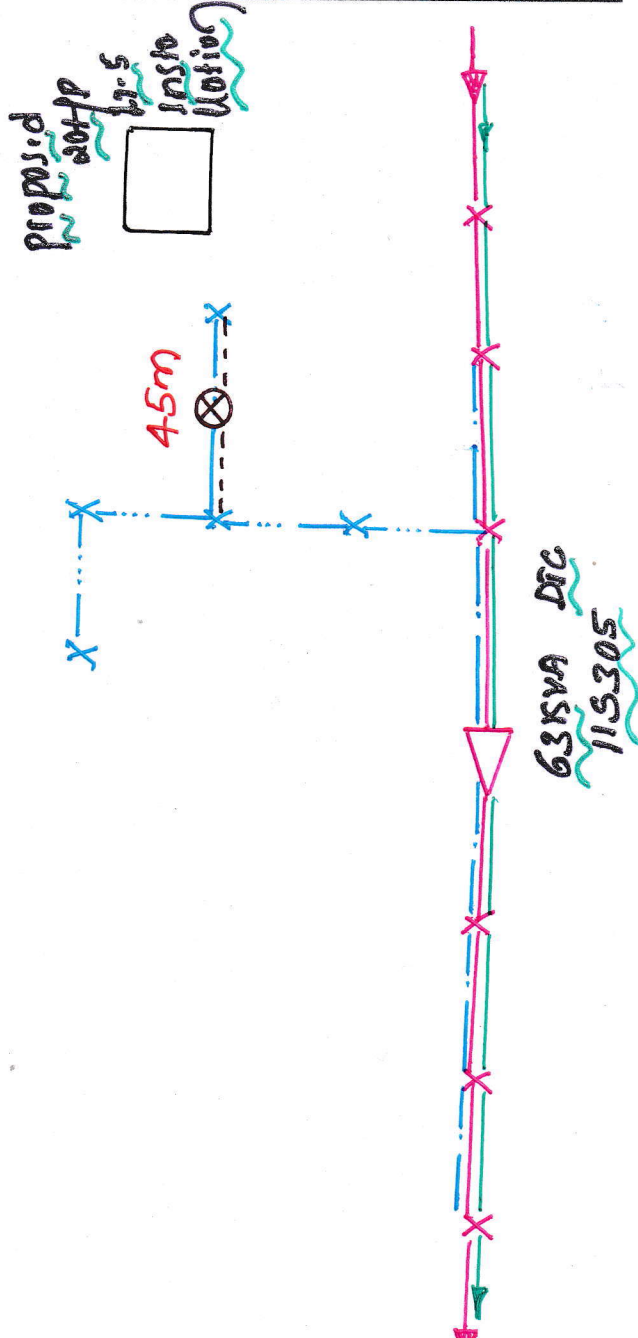

Asst. Executive Engineer (Elec.),
 Chamundipuram Sub-Division,
 C.E.S.C., Mysuru.

(Signature)
 Assistant Engineer (Elec.),
 O&M Kadakola Section,
 C.E.S.C., Mysuru.

CHAMUNDESHWARI ELECTRICITY SUPPLY CORPORATION LTD.,




mate No: SOK-397

Date: 29/08/2022.

Sketch Shows for APS to 1No's of Power installation's (LT-5) of 20HP load infavour of Sri.Prasanthkumar K.M S/o Mahadevappa K.S
 anana Floor Mill) Site No-29 @ Gejjagalli Village Limits pertains to O&M-Kadakola Section of Chamundipuram Sub-Division.

INDEX

- Existing 115V 4 wire HT line
- Existing 115V 3P HT line
- △ Existing 63KVA DTC
- Existing 4 wire 400V LT
- X Existing 8mH 4w/psc poles
- Existing 3 wire HT line
- - - Proposed single wire HT line
- ⊗ Proposed 8mH psc pole.

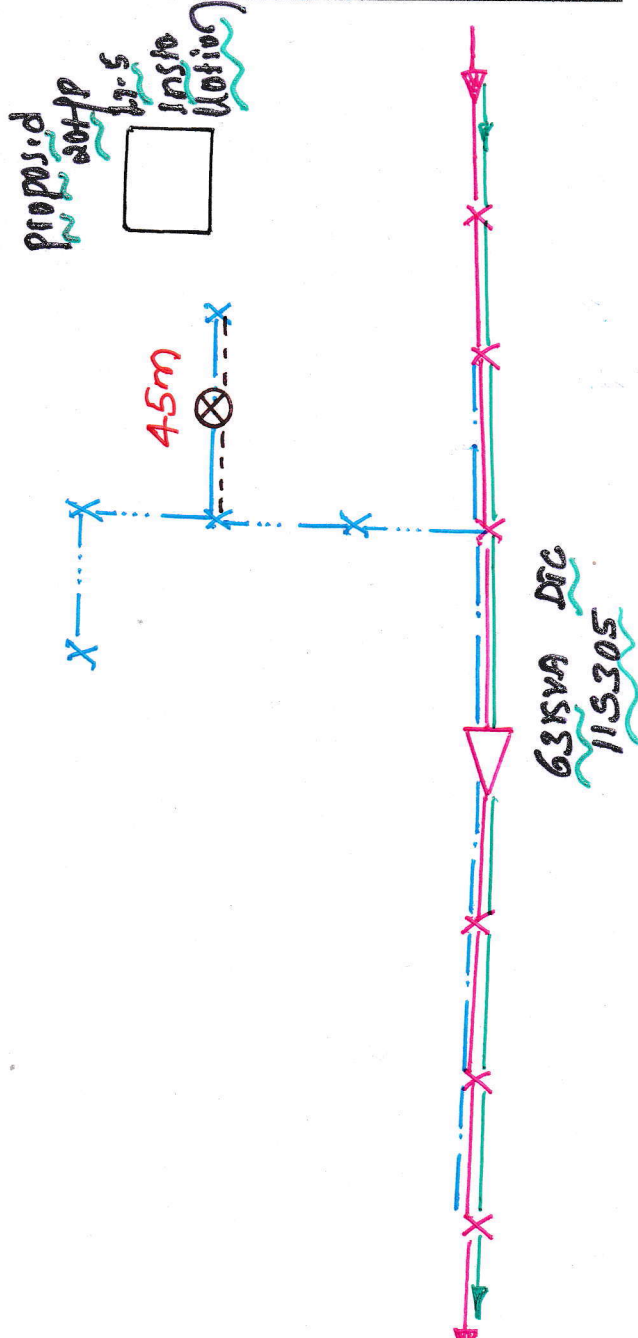

Asst. Executive Engineer (Elec.),
 Chamundipuram Sub-Division,
 CESC, Mysuru.

[Signature]
 Assistant Engineer (Elec.),
 O&M Kadakola Section,
 CESC, Mysuru.