






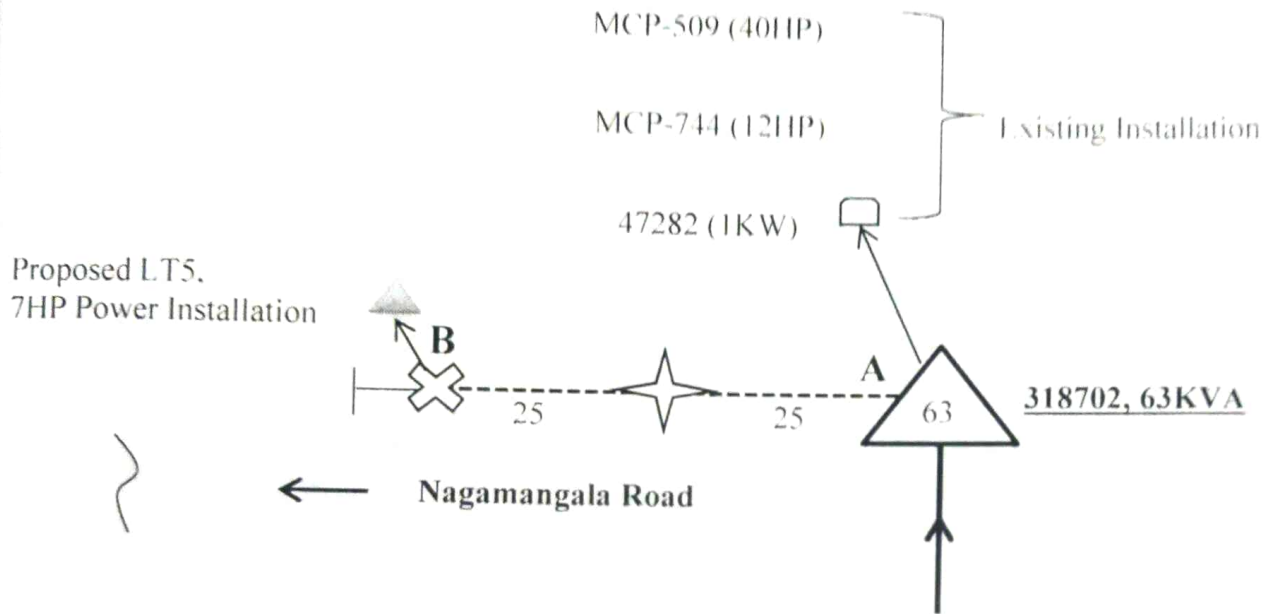

Sketch for enhancement of existing good 63KVA transformer by good 100KVA transformer ( TC code:318702 ) for arranging power supply to 7HP, LT5 Power installation in favouring of Sri. Mukthar Pasha s/o Mahammad Peer, Kno. D8/1930/1930 at Nagamangala Road, Mandya in Sugar Town section, Mandya sub division, Mandya.

TC CODE:318702, CAP:63KVA, KUSUMALATHA TC



**INDEX**

	Existing 11KV KHB Feeder
	Existing Good 63KVA Proposed for Enhancement in to 100KVA DTC
	Proposed LT 5wire installation
	Proposed 8Mtr long RCC pole
	Proposed 8Mtr long PSC pole
	Proposed LT5, 7HP Power Installation

✓ Asst. Executive Engineer [Elecl],  
CESC, MSD, Mandya.

Junior Engineer (Ele)  
CESC, Sugar Town Section,  
Mandya.