


**TC CODE:315733, CAP:63 KVA, Devegowdana doddi IP TC**

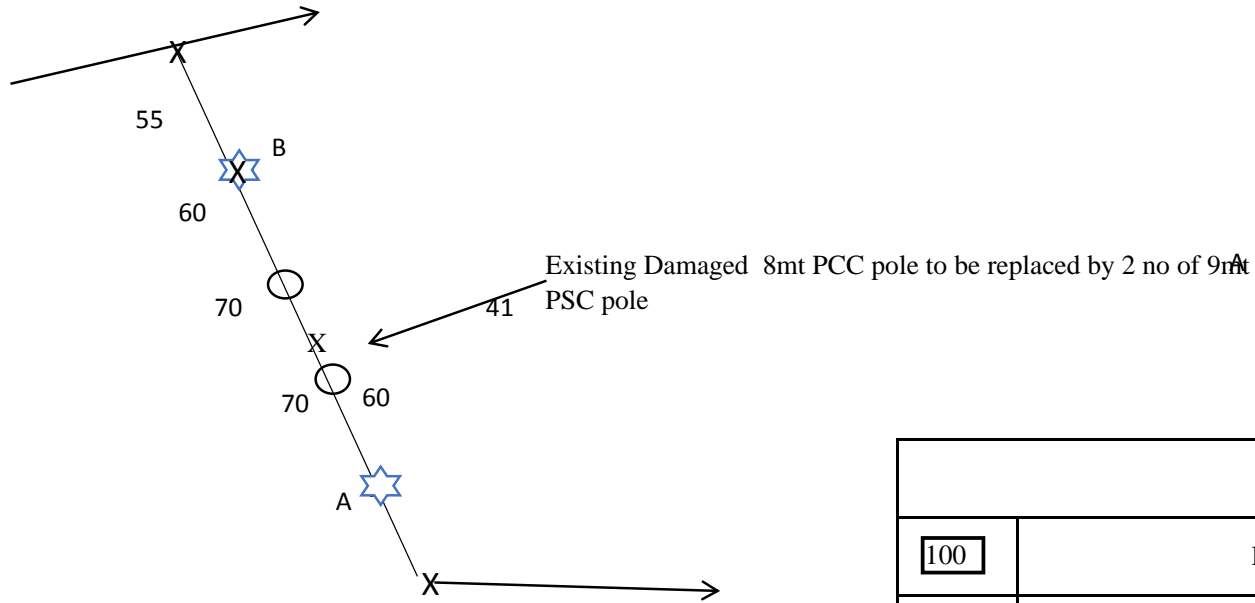

INDEX	
100	Existing 25KVA DTC
—X—	Existing LT 4Wire line
○	Proposed 9mt PSC pole
☆	Straightening of Slanted pole
↙	proposed LT guy set
A to B	Releasing & re-errection of 4 wire LT line

Asst.Executive Engineer  
CESC, MSD, Mandya.

Assistant Engineer [Elecl.]  
CESC, Sugar town Section,  
Mandya.