


Mall of Mysore
 114601
 100KVA

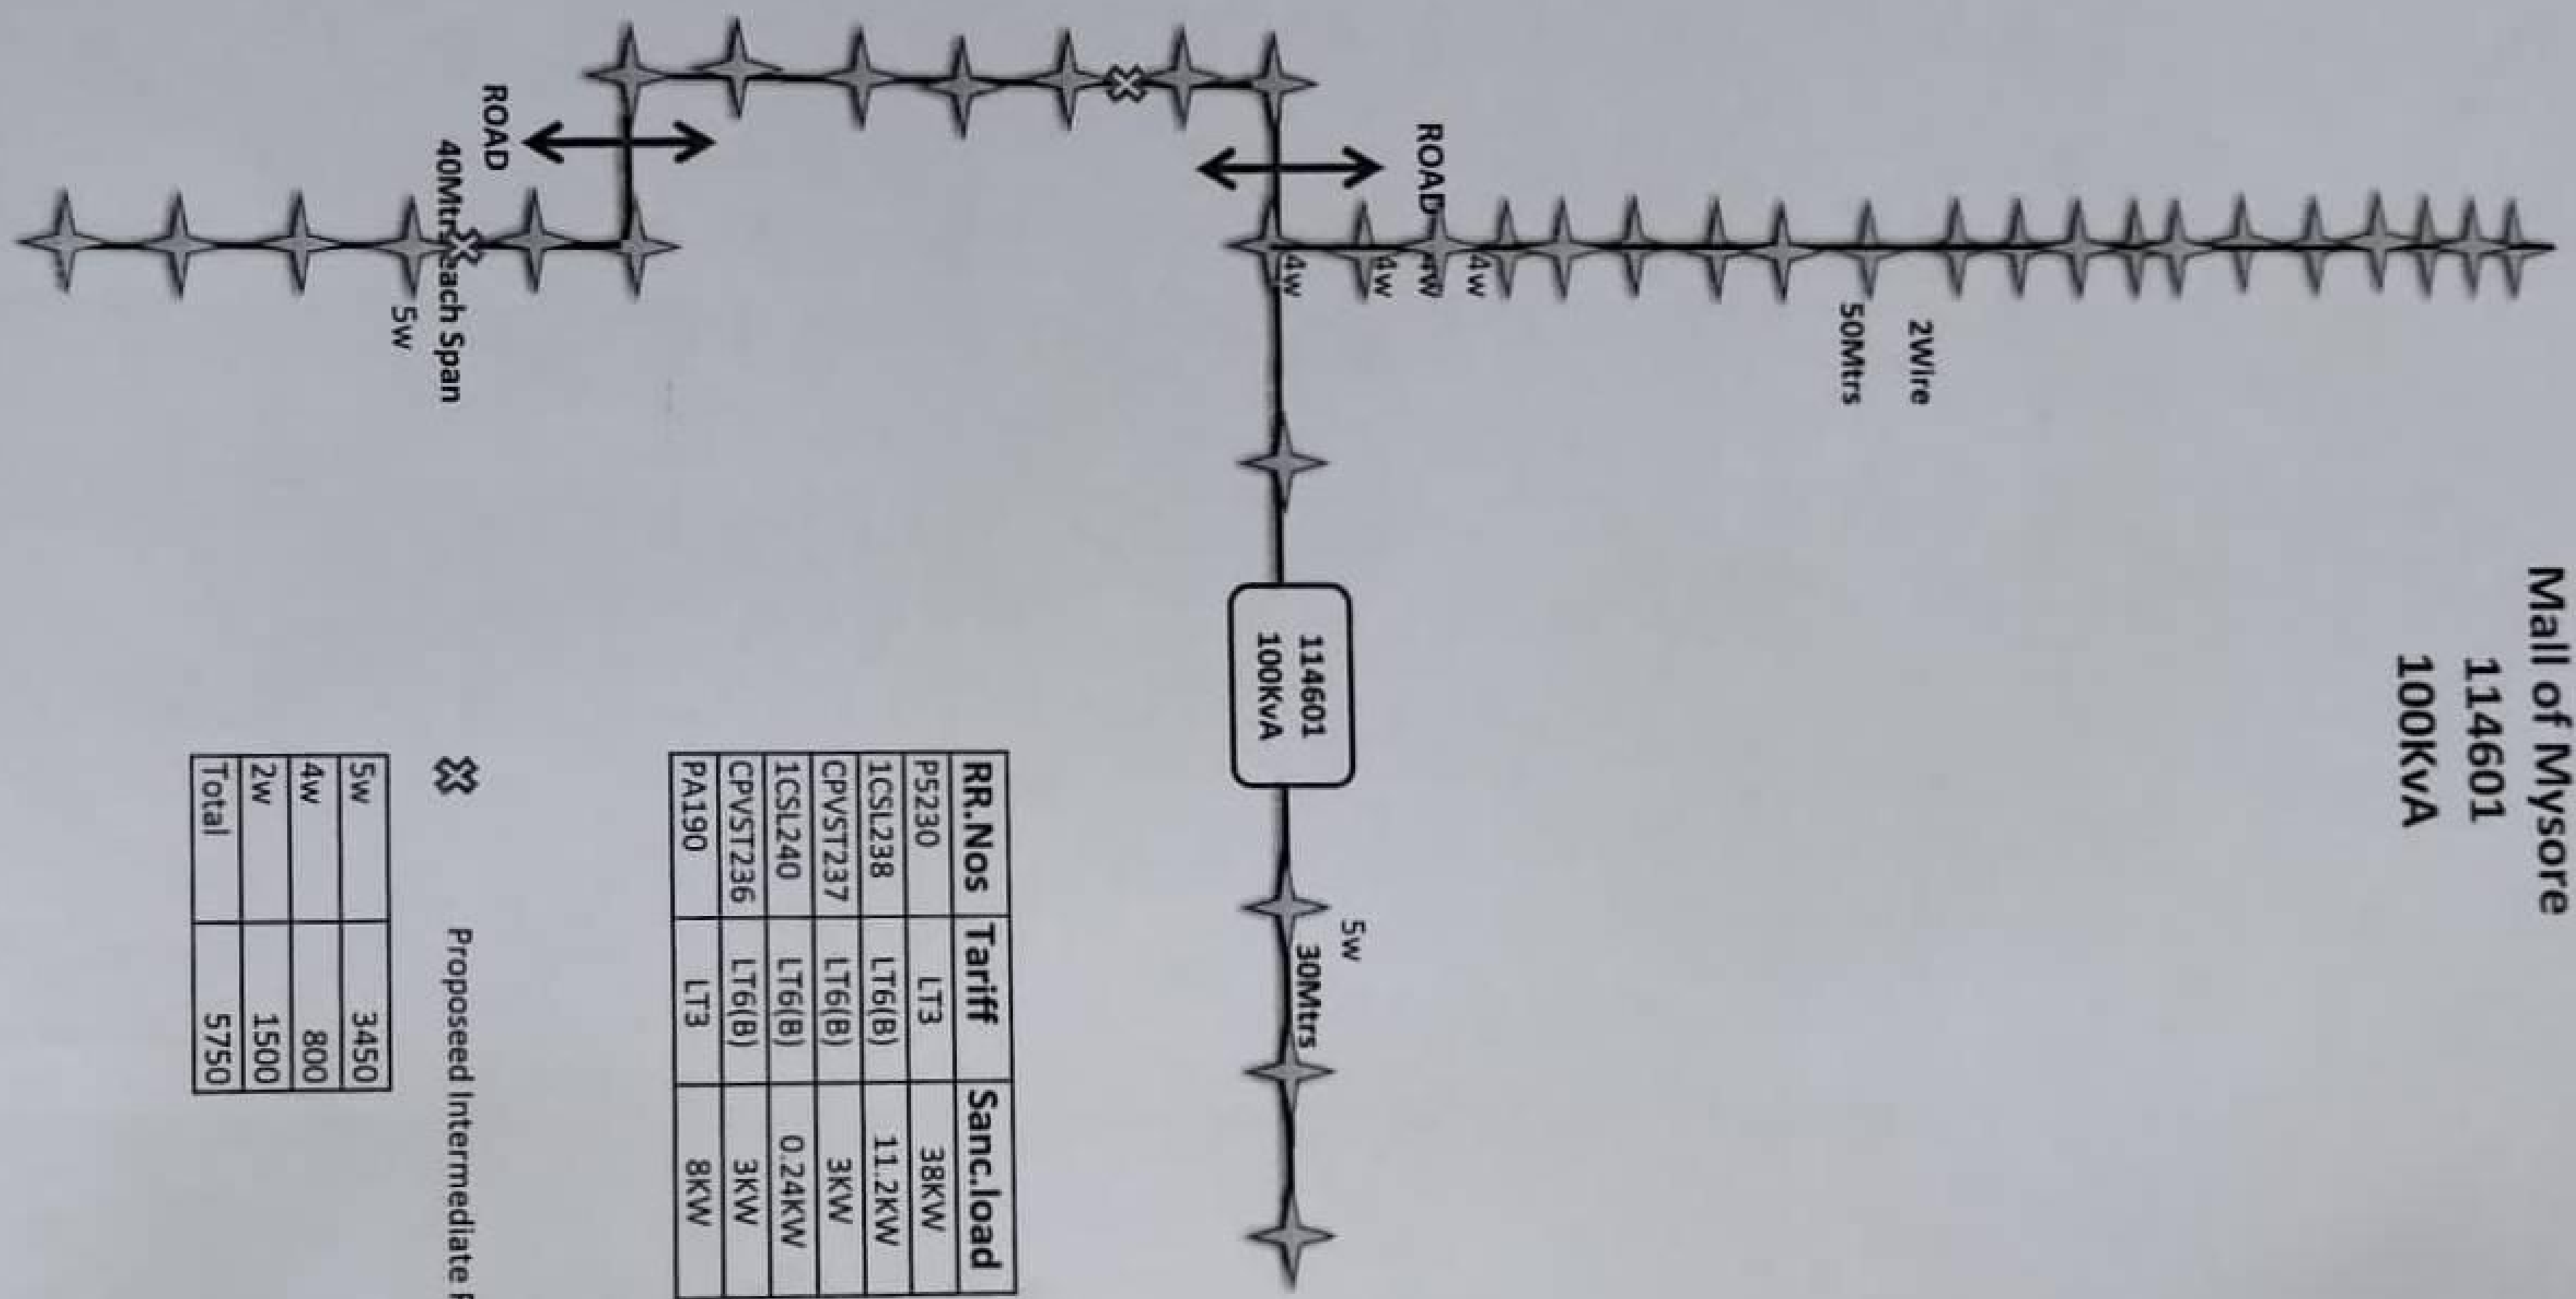

RR.Nos	Tariff	Sanc.load
PS230	LT3	38KW
1CSL238	LT6(B)	11.2KW
CPVST237	LT6(B)	3KW
1CSL240	LT6(B)	0.24KW
CPVST236	LT6(B)	3KW
PA190	LT3	8KW

✕ Proposed Intermediate Pole

5w	3450
4w	800
2w	1500
Total	5750